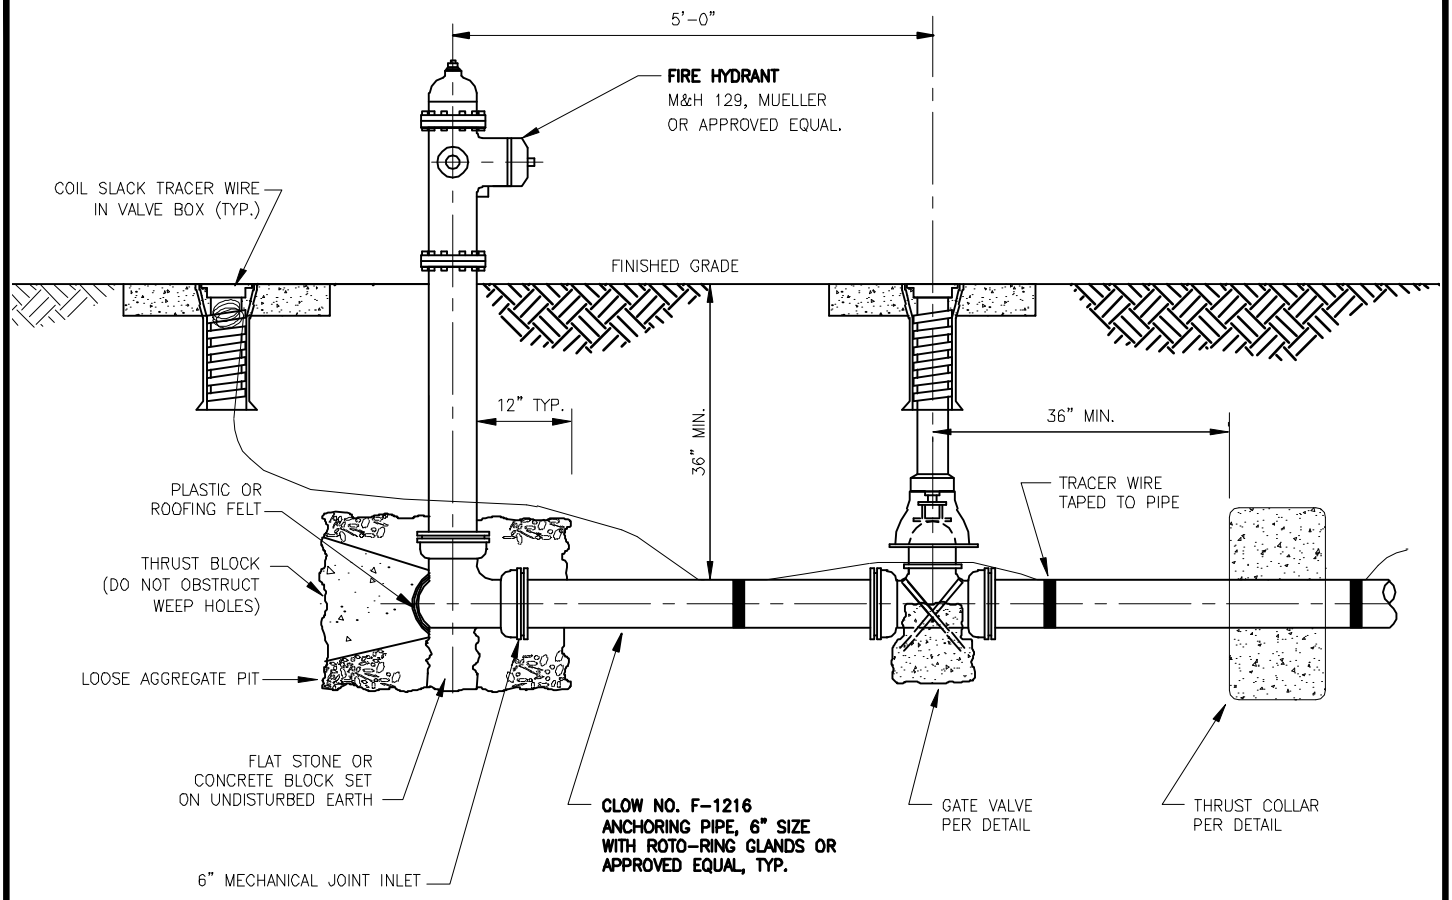

NOTES:

1. RESTRAIN ALL PIPE & FITTINGS SHOWN THIS SHEET.

JCWSA STANDARD DETAIL C-10
DEAD END FIRE HYDRANT ASSEMBLY

SCALE: NTS

DATE OF LAST REVISION: 12/06

JACKSON COUNTY
WATER & SEWERAGE AUTHORITY