


PLAN

NOTES:

1. 2" PVC PIPE TO BE NSF APPROVED FOR POTABLE WATER, ASTM-D 2241 SDR 13.5.
2. 2" PVC FITTINGS TO BE RUBBER GASKET TYPE, RESTRAINED AS REQ'D. SOLVENT WELD FITTINGS ARE NOT ACCEPTABLE.
3. LOT TAPS SHALL OCCUR BEFORE WATER SAMPLER.
4. THIS DETAIL IS NOT APPLICABLE WHERE LOOPING OR FUTURE CONTINUATION OF MAIN IS REQUIRED.

KEY

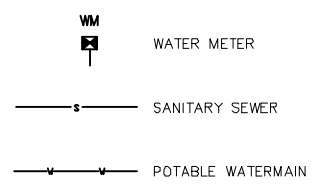

JCWSA STANDARD DETAIL C-2
WATERLINE LOCATION IN CUL DE SAC
SCALE: NTS
DATE OF LAST REVISION: 12/06

