



HORIZONTAL SEPARATION

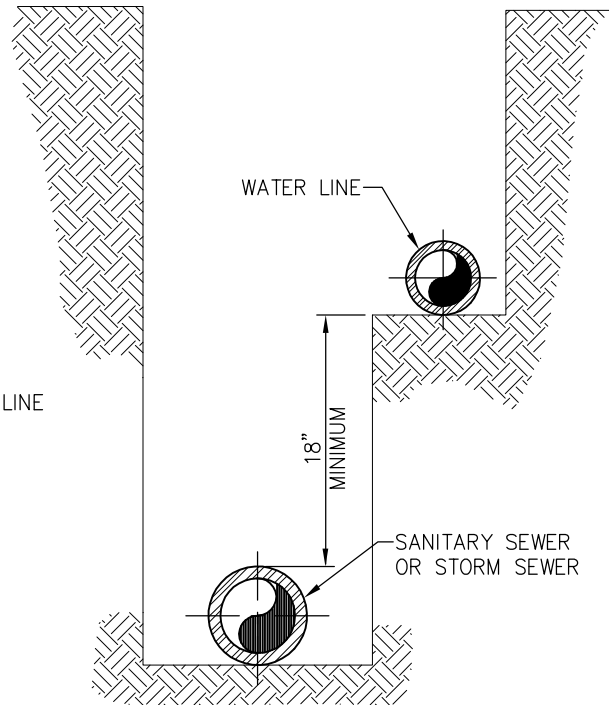

VERTICAL SEPARATION

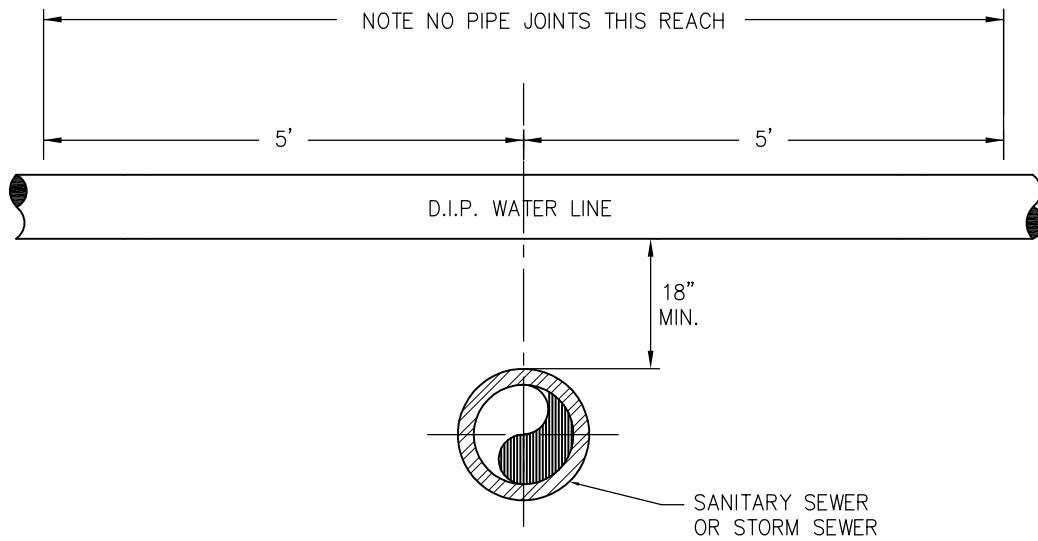

SEPARATION AT CROSSINGS

NOTES:

1. WHERE MINIMUM CLEARANCES CANNOT BE MAINTAINED, ALTERNATE PROCEDURES ARE REQUIRED. REF. AUTHORITY STANDARDS

**JCWSA STANDARD DETAIL C-3
WATER & SEWER CLEARANCE**

**SCALE: NTS
DATE OF LAST REVISION: 12/06**

**JACKSON COUNTY
WATER & SEWERAGE AUTHORITY**

